


A	
B	

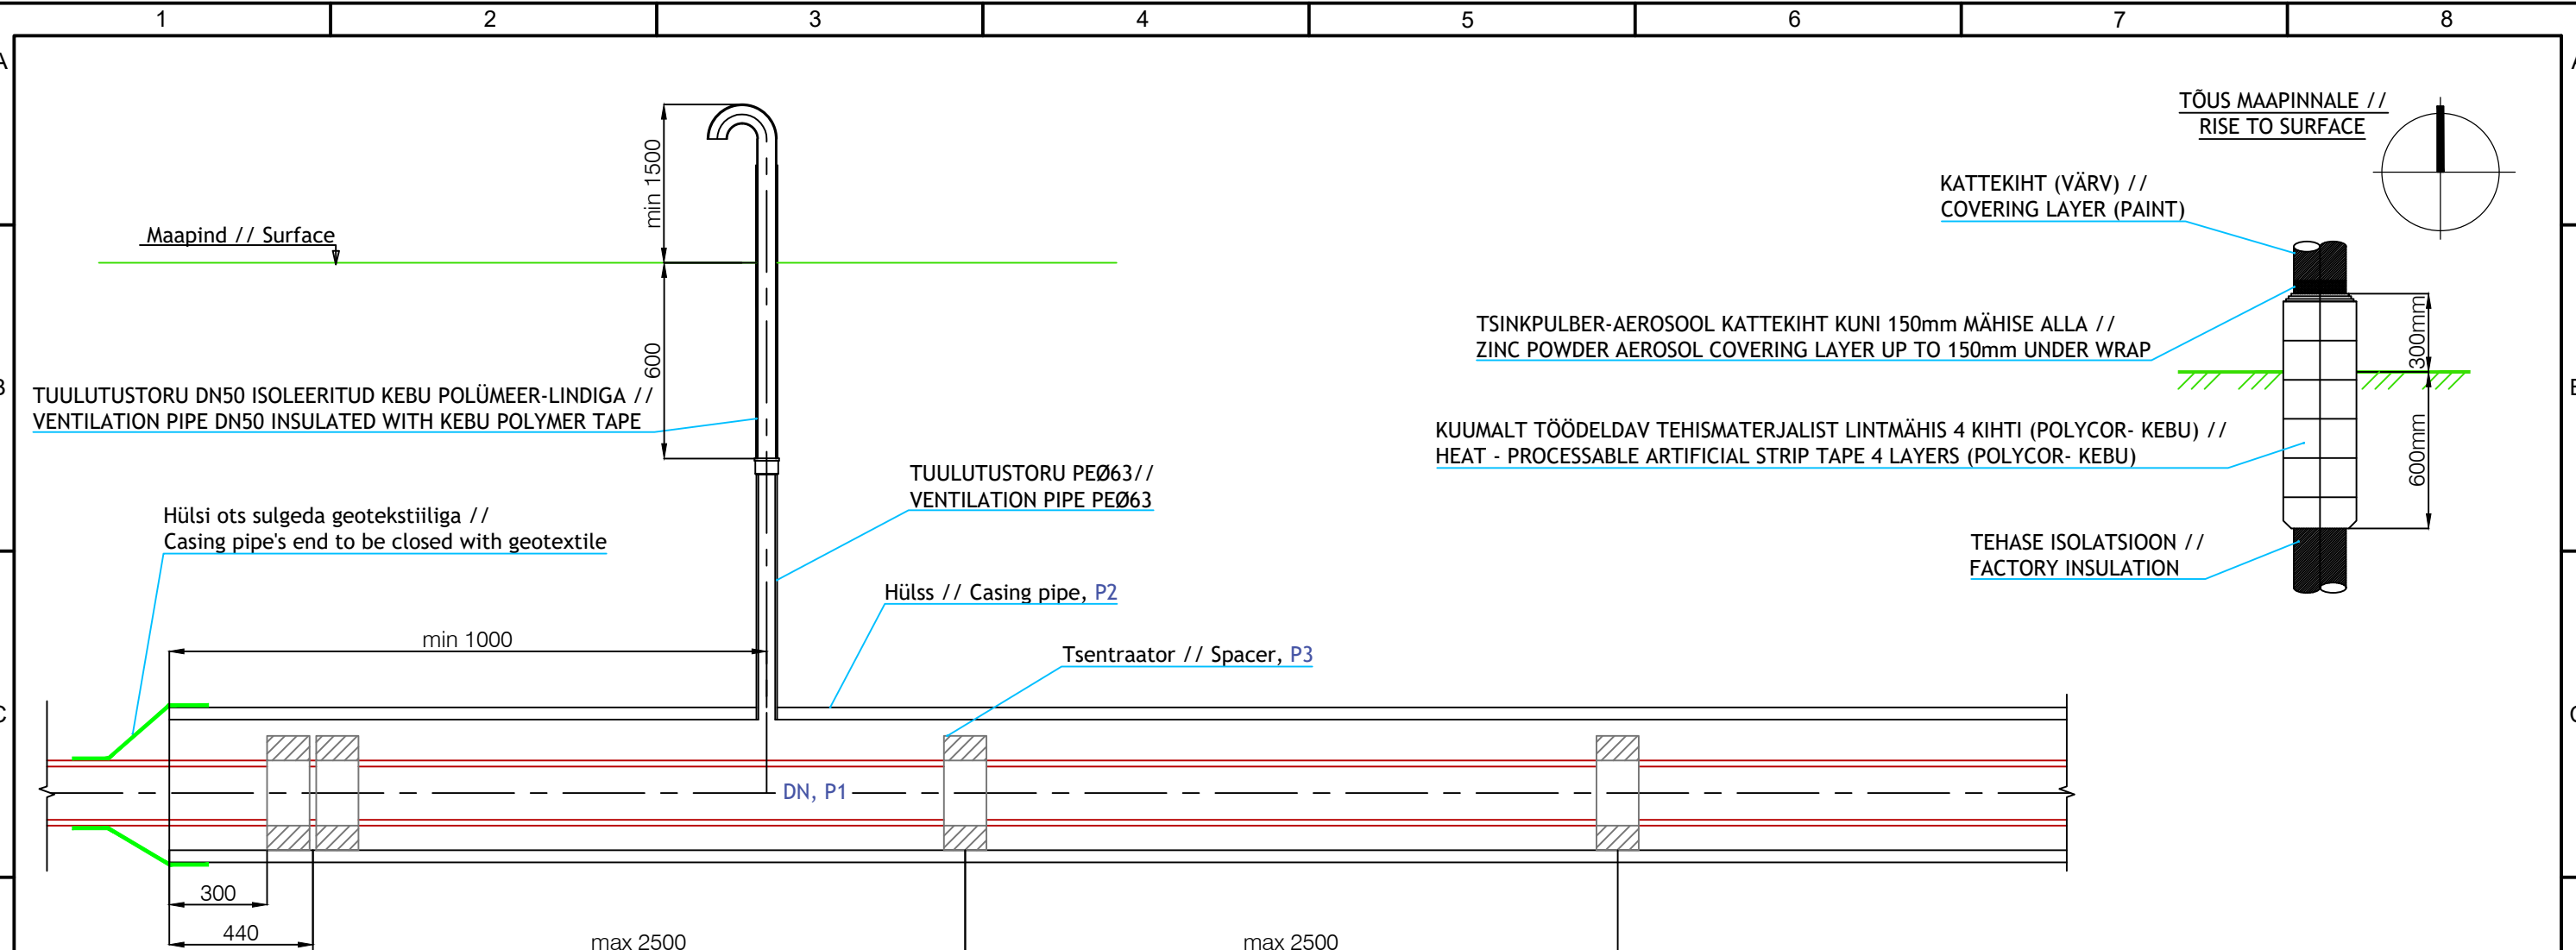

P1	P2	P3	P5	P6	P7
TORU DN // PIPE DN	HÜLSI DN // CASING PIPE DN	TSENTRAATORI TÜÜP JA KÕRGUS // SPACER'S TYPE AND HEIGHT	HÜLSI PIKKUS, m // CASING PIPE LENGHT, m	RÕNGASTE ARV, tk/hüls // RINGS' QUANTITY, pcs/pipe	ELEMENTIDE ARV ÜHELE HÜLSILE, tk // NUMBER OF ELEMENTS PER CASING PIPE, pcs
PEØ200	PEØ400	RACI, F/G, h=41mm	98,8	43	86
PEØ200	PEØ400	RACI, F/G, h=41mm	59,7	27	54
PEØ200	PEØ400	RACI, F/G, h=41mm	27,7	15	30
PEØ200	PEØ400	RACI, F/G, h=41mm	22,8	13	26

MÄRKUSED // NOTES:

1. Maksimaalne vahe tsentraatorite vahel torul PEØ200 on 2.5m // Maximum spacing between spacers on pipe PEØ200 is 2.5m.
2. Kõik maapealsed gaasitorustikud värvida kollase kattevärviga kahes kihis // All above ground gas pipelines shall be painted with a yellow coating in two layer

[illegible]

DO NOT SCALE FROM THIS DRAWING

