




T-HARU HS-1
2xDN150/280 - DN65/160

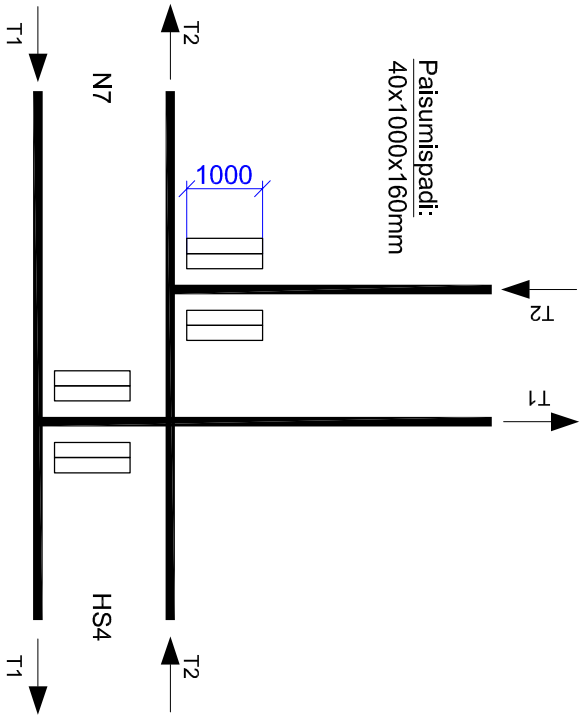


T-HARU HS-5
2xDN125/250 - DN40/125

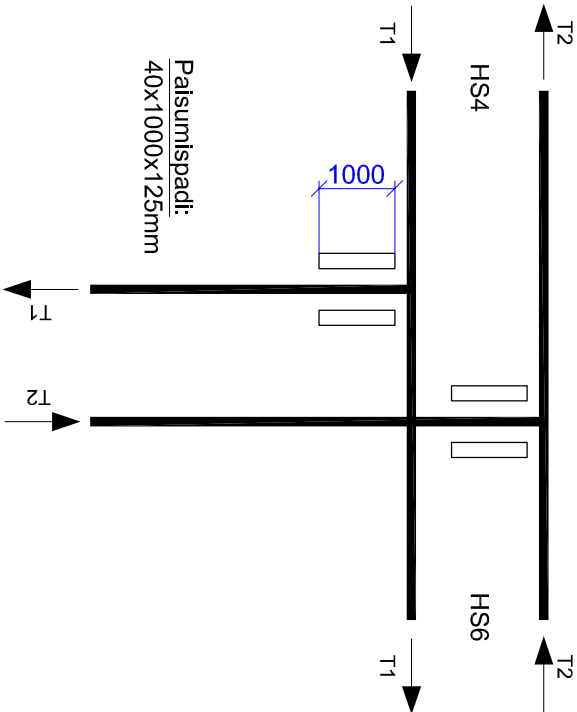


T-HARU HS-3
2xDN50/140 - DN32/125

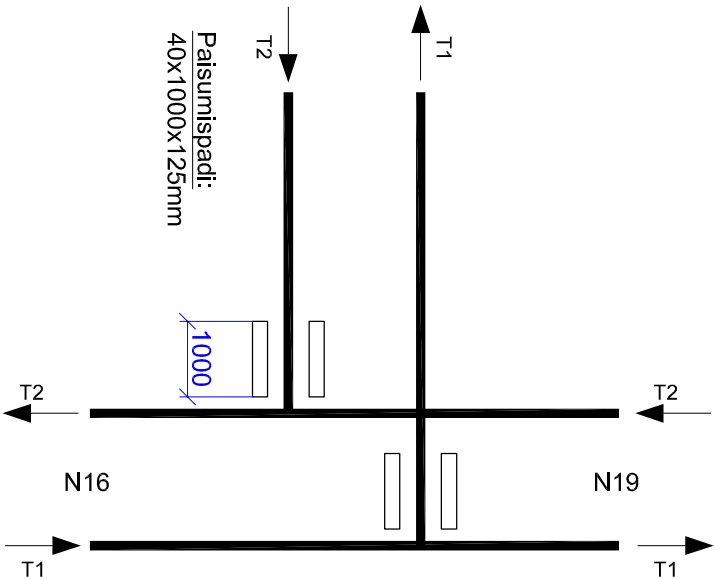


T-HARU HS-4
2xDN125/250 - DN32/125

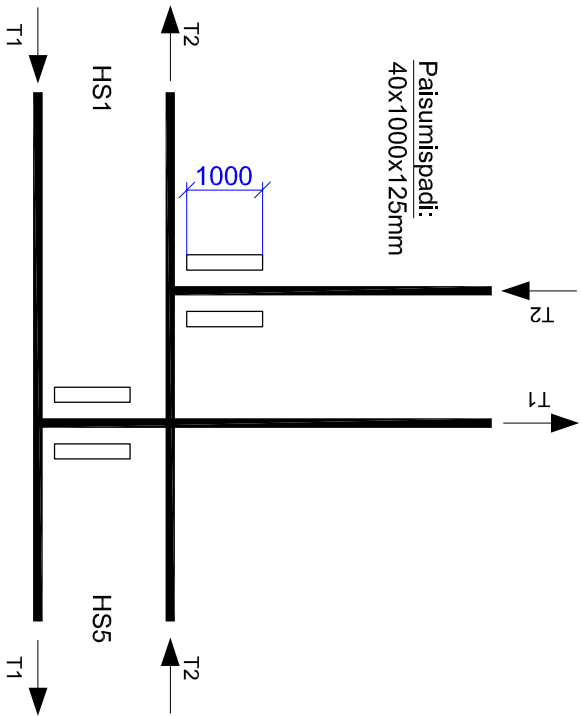

T-HARU HS-6
2xDN125/250 - DN32/125

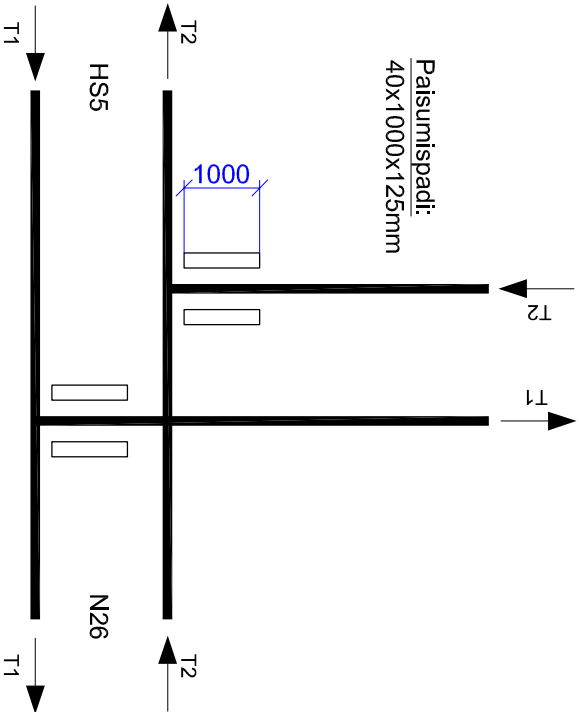

...
KAUPÄEV	MUUDATUSE NR.	TEOSTAS	ALKIRI
 HeatConsult		Töö nr:	13-030
HeatConsult OÜ reg. nr 12049882 Käusepaati 6-31, 11412 Tallinn tel: +372 58 00 39 89 info@heatconsult.ee		Tellijä: EG Ehitus AS Radtsit tee 7, Soodevahe, 75322 Rae vald reg. nr 11097051 tel: +372 6 580 240 faks: +372 6 580 241	Objekti asukoht: NISSI TEE, METSA TÄNAV, RIISIPERE ALEVIK, NISSI VALD, HARJUMAA
Inseener	V. Kislenskova	27.06.2013	Töö nimetus:
Kontrollis	A. Ledvanov	27.06.2013	RIISIPERE ALEVIKU SOOJUSTRASSIDE REKONSTRUEERIMINE
			Joonise nimetus:
			PAISUMISPATJADE SKEEM
Fail	13-030 ST-6 Paisumispatjad.dwg		