DO NOT SCALE FROM THIS DRAWING

Kaabli paigaldus haljasala alla
Cable installation under the green area

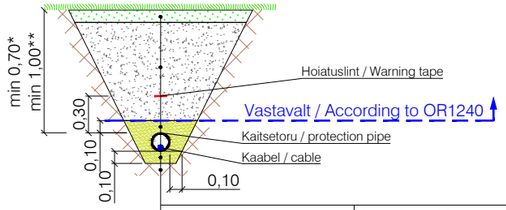

Vastavalt OR1240	According to OR1240	
Vastavalt OR1240	According to OR1240	
Liivast algtäide Kf>0.5 m/ööp	Initial filling of sand Kf>0.5 m/night)	toru/ pipeØ+10cm
Liivapadi Kf>0.5 m/ööp	Sand pillow Kf>0.5 m/night	10cm
Olemasolev pinnas	Existing soil	

Kaabli paigaldus jalgratta- ja jalgtee asfaltkatte alla
Cable installation under the asphalt covering of bicycle and footpaths

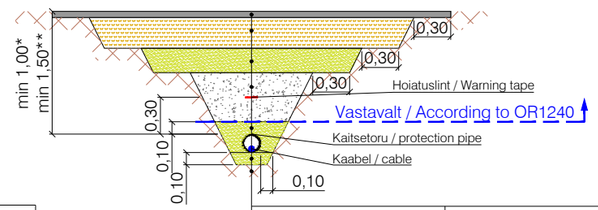

Vastavalt OR1240	According to OR1240	
Vastavalt OR1240	According to OR1240	
Vastavalt OR1240	According to OR1240	
Vastavalt OR1240	According to OR1240	
Liivast algtäide Kf>0.5 m/ööp	Initial filling of sand Kf>0.5 m/night)	toru/ pipeØ+10cm
Liivapadi Kf>0.5 m/ööp	Sand pillow Kf>0.5 m/night	10cm
Olemasolev pinnas	Existing soil	

Haljasala taastamine
Greenarea restoration

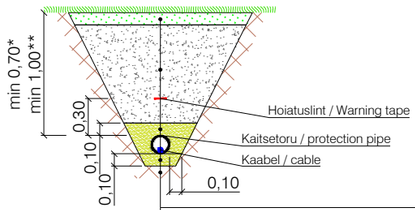

Sõelutud mineraalmuld kasvukihina, murukülv 20g/m²	Screened mineral soil as growth layer, grass seeding 20 g/m²	10cm
Tagasitäide (Kt=0.98, Kf≥0.5 m/ööp) (märkus 4)	Backfill (Kt=0.98, Kf≥0.5 m/night) (note 4)	
Liivast algtäide Kf>0.5 m/ööp	Initial filling of sand Kf>0.5 m/night)	toru/ pipeØ+10cm
Liivapadi Kf>0.5 m/ööp	Sand pillow Kf>0.5 m/night	10cm
Olemasolev pinnas	Existing soil	

Kaabli paigaldus sõidutee asfaltkatte alla
Cable installation under the asphalt pavement of the roadway

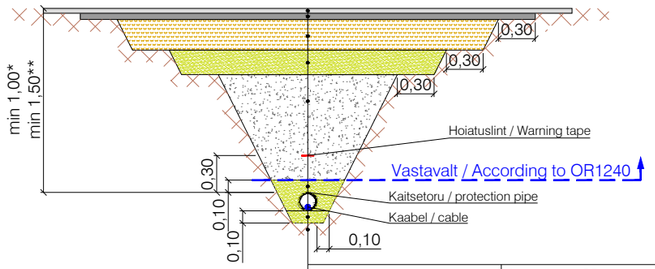

Vastavalt OR1240	According to OR1240	
Vastavalt OR1240	According to OR1240	
Vastavalt OR1240	According to OR1240	
Vastavalt OR1240	According to OR1240	
Vastavalt OR1240	According to OR1240	
Liivast algtäide Kf>0.5 m/ööp	Initial filling of sand Kf>0.5 m/night)	toru/ pipeØ+10cm
Liivapadi Kf>0.5 m/ööp	Sand pillow Kf>0.5 m/night	10cm
Olemasolev pinnas	Existing soil	

Kaabli paigaldus killustik- või kruuskatte alla
Cable installation under a splinter or gravel cover

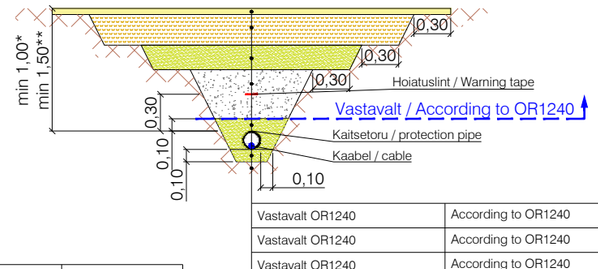

Vastavalt OR1240	According to OR1240	
Vastavalt OR1240	According to OR1240	
Vastavalt OR1240	According to OR1240	
Vastavalt OR1240	According to OR1240	
Liivast algtäide Kf>0.5 m/ööp	Initial filling of sand Kf>0.5 m/night)	toru/ pipeØ+10cm
Liivapadi Kf>0.5 m/ööp	Sand pillow Kf>0.5 m/night	10cm
Olemasolev pinnas	Existing soil	

MÄRKUSED:

1. Mulla huumuse sisaldus peab olema vähemalt 3%. Kasvumuld peab olema mineraalmuld nõrgalt happelise või neutraalse reaktsiooniga (ph 4.0...7.5). Võimalik on kasutada olemasolevat kooritavat kasvupinnas, mis sialdada huumust, kuid ei sisalda suuri kive ja taimede kahjulikke jäätmeid ning tihendad nii, et ei tekiks vajumisi ja vee kogumise lohkusid.
2. Ei tohi kasutada külmunud pinnast ja turvast.
3. "Tee ehitamise kvaliteedi nõuded", MTM 03.08.2015, määrus nr. 101, lisa 10.
4. Täitematerjal ei tohi sisaldada suuri kive (≥15 cm), kõrvalisi esemeid, turvast, pehmet savi, puidu- või raadamisjäätmeid, jääd, lund ja külmunud pinnast (pinnasekamakaid), muid kahjustavaid ainedi ning jäätmeid. Talvetingimustest kasutada tagasitäitena ainult sulasid ja kergesti tihendatavaid materjale.
5. Tehnoloogiliste abikaevikute suurused täpsustada ehitusekäigus sõltuvalt vajadusele. Kaevikute nõlvade lubatud kalded rajada vastavalt "Tööohutus ehitusplatsil" Tööinspektsiooni juhendile.
6. * KOV asutustusüksustel
7. ** Transpordiameti riigiteemaa-alal

NOTES:

1. The humus content of the soil shall be at least 3%. The growing soil must be mineral soil with a weakly acidic or neutral reaction (pH 4.0 ... 7.5). It is possible to use an existing peeling soil that contains humus, but does not contain large stones and harmful plant waste, and compacts so that there is no subsidence and water collection depressions.
2. Frozen soil and peat must not be used.
3. "Quality requirements for road construction", MTM 03.08.2015, regulation no. 101, Annex 10.
4. Aggregates must not contain large stones (≥15 cm), foreign objects, peat, soft clay, wood or deforestation waste, ice, snow and frozen soil (lumps of soil), other harmful substances and waste. From winter conditions, use only molten and easily compacted materials as backfill.
5. The sizes of the technological auxiliary trenches should be specified during the construction process depending on the need. Permissible slopes of the slopes of the trenches should be built in accordance with the "Occupational safety on the construction site" instructions of the Labor Inspectorate.
6. * Local government institutional units
7. ** In the state theme of the Transport Board

MUUDATUSED / REVISIONS			Koostaja / Originator	Kontrollija / Checker	Kinnitaja / Approver
Nr/No	Kuupäev/Date	Kirjeldus / Description			
001	06/08/2024		A. Klibanov	A. Klibanov	G. Laagus
002	11/02/2025		A. Klibanov	A. Klibanov	A. Mägi

Kaasrahastab Euroopa Liit Euroopa ühendamise rahastu
Co-financed by the Connecting Facility of the European Union

PROJEKT / PROJECT
LEPINGU NR / CONTRACT NO. 2024-K016

Rail Baltica

RB Raplamaa põhitrassi raudteetaristu II etapp / Stage II of railway infrastructure of the RB main line in Rapla County

ARHIIVI NR / ARCHIVE NO.

TELLIJA / CLIENT
Rail Baltic Estonia OÜ
Veskiposti 2/1, 10138
Tallinn, Estonia
Reg.no. 12734109

ALLTÖÖVÕTJA / SUB-CONTRACTOR
Reaalprojekt OÜ
Tallinna 45, 71008
Viljandi, Estonia
Reg.no. 10765904

TÖÖVÕTJA / CONTRACTOR
Verston
VERSTON EESTI OÜ
Sepise 7
11415 Tallinn, Estonia
Reg.no. 11947047

KUUPÄEV / DATE: 11/02/2025
MÕÕTKAVA / SCALE: 1:50
FORMAAT / PAPER SIZE: A3
DRAWING STATUS: TP / DTD

	NIMI / NAME	ALLKIRI/SIGNATURE	KUUPÄEV/DATE
KOOSTAJA / ORIGINATOR	A. Klibanov		11/02/2025
KONTROLLIJA / CHECKER	A. Klibanov		11/02/2025
ÜLEVAATAJA / REVIEWER	T. Sadam		11/02/2025
KINNITAJA / APPROVER	A. Mägi		11/02/2025

JOONISE NIMETUS / DRAWING TITLE
Kaeviku ristõiked / Trench sections

PROJEKTI KOOD / PROJECT CODE			ASUKOHT / LOCATION			ERIOSA / DISCIPLINE CODE		
PROJEKTI ID PROJECT ID	LÕIGU ID SECTION ID	ALALÕIGU ID SUB-SECTION ID	OSA/SÜSTEEM VOLUME/SYSTEM	TSOON/ ZONE	ASUKOHT LOCATION	RBR KOOD RBR CODE	KOHALIK KOOD LOCAL CODE	STAADIUM PROJECT STAGE
RBDTD-EE	DS1	DPS2	OU1130	ZZ	0003	ED	EL	TP/DTD

LEHE PEALKIRI / SHEET NAME: RBDTD-EE-DS1-DPS2_VER_OU1130-ZZ_0003_D3_ED-EL_DTD_006002
MUUDATUS / REVISION: 002
LEHE NUMBER / SHEET NUMBER: 1