




The diagram shows a horizontal line representing a road. Above the line, a double-headed arrow indicates a total length of 16 m. Below the line, a smaller double-headed arrow indicates a section of 7 m, which is labeled 'Asphalt' underneath. A red box on the left contains the text 'Algust.' with a red line pointing to the start of the 7m asphalt section.

Ettevaatust! Olemasolev maakaabel.
Täpne sügavus täpsustada enne
kaevetööde algust.
Orienteeruv sügavus 1 m.

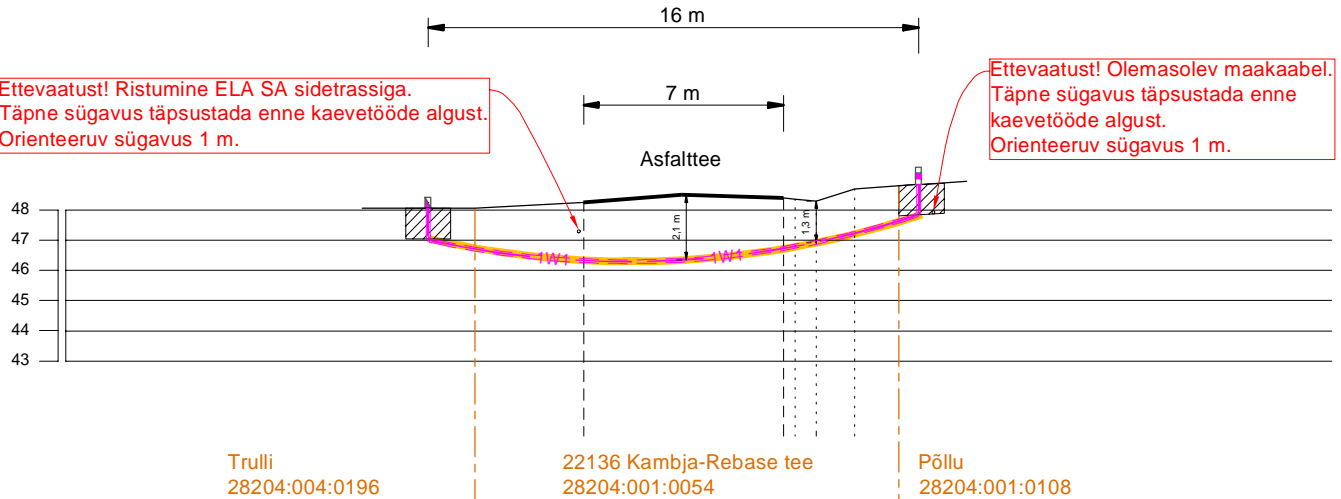

- 1) Paigaldussügavus peab olema teemulde all min 1,5 m mullet ümbritsevast maapinnast
- 2) Paigaldussügavus teemaal, mulde nõlvast kuni 1 m kaugusel 1,2 m
- 3) Paigaldussügavus teemaal, mulde nõlvast kaugemal kui 1 m 1 m
- 4) Ristumised kraaviga teha min 1 m altpoolt kraavi põhjaja ristumised truubiga 1 m altpoolt truubi põhja.
- 5) Puurimiskaevik teha min 1 m kraavi servast.
- 6) Paigaldussügavus teepeirde all min 2,5 m.

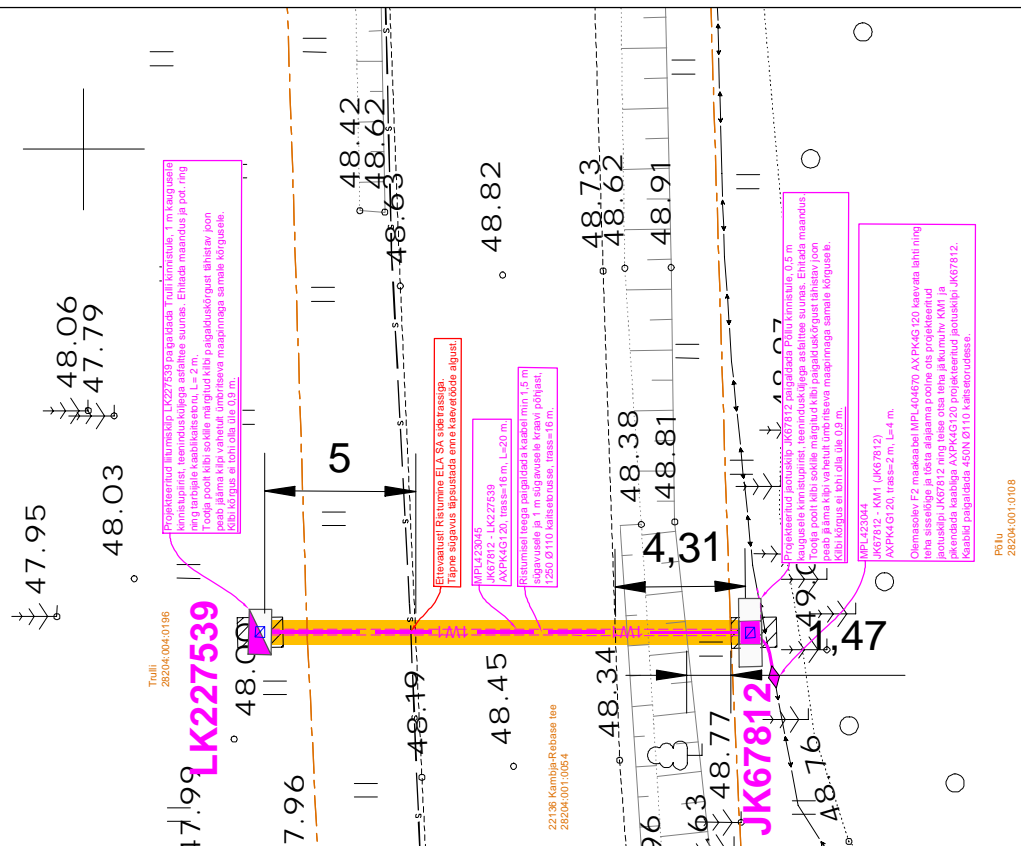

Projekt						Tellija		
Trulli kinnistu elektriliitumine. Lalli küla, Kambja vald, Tartu maakond						Elektrilevi OÜ		
<div> LEONHARD WEISS</div> <div>LEONHARD WEISS OÜ E-post estonia@leonhard-weiss.com Telefon +372 601 2285 Registrikood 12083348 EE101756486</div>	Joonis		Ristmäväli			Joonise nr LC0846_TP_EL-4-02		
	Projektteeris	Raido Rebane		06.02.2024	+372 5699 8445	Mõõtkava	M 1: 250	
	Kontrollis	Andres Mee		06.02.2024	+372 511 9005	Staadium	Tööprojekt	
	Projektijuht					Keel EST	Leht 1	Lehti 1